


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		

DATA OF LAMP		PHOTOMETRIC DATA Eff: 81.00 lm/W			
Lamp Model: 1146_NA_WHT_OV_HE_450mA_4000K CRI90	1300lm 940 HV ADV5	Imax(cd)	1039	S/MH(C0/180)	1.21
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	1.16
RATED VOLTAGE(V)	230.0	TOTAL FLUX(lm)	2668.4	η UP,DN(C0-180)	0.0,49.7
NOMINAL FLUX(lm)	2668.41	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.3
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	1.25
TEST VOLTAGE(V)	230	η down(%)	100.0	CIBSE SHR MAX	1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

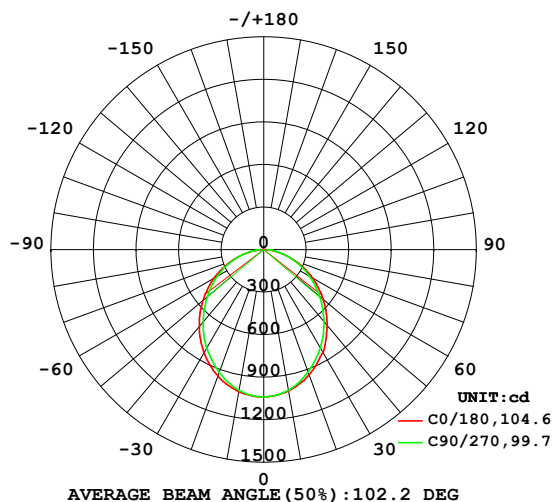

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

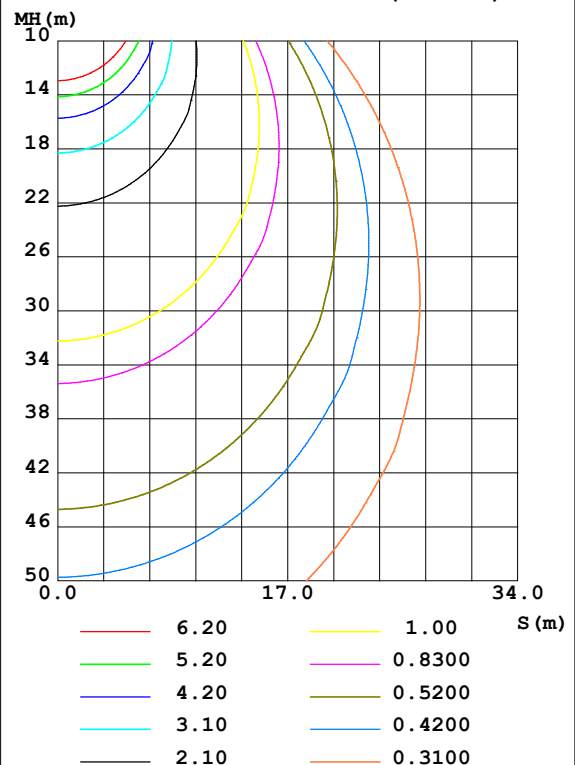

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum,lamp
10	1012	1008	1006	1012	1017	1013	1008	1010	0- 10	97.83	97.83	3.67,3.67
20	938.9	926.8	917.4	932.5	948.2	934.7	920.2	929.0	10- 20	275.0	372.9	14,14
30	834.9	808.7	798.6	815.8	841.4	819.1	802.9	811.9	20- 30	403.7	776.5	29.1,29.1
40	696.0	675.5	661.3	682.6	708.5	687.4	665.4	680.0	30- 40	470.0	1247	46.7,46.7
50	548.9	530.6	514.8	537.4	560.6	542.4	520.7	535.5	40- 50	470.1	1717	64.3,64.3
60	395.1	380.6	369.5	386.3	405.5	393.7	378.9	387.8	50- 60	412.6	2129	79.8,79.8
70	238.9	232.1	228.4	236.3	247.3	246.6	239.7	241.9	60- 70	309.6	2439	91.4,91.4
80	90.37	95.29	100.3	98.10	95.90	106.8	109.3	103.6	70- 80	176.9	2616	98,98
90	0.9579	14.77	22.79	15.15	1.049	11.15	17.47	10.02	80- 90	52.56	2668	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1485.5 lm

%lum = 55.7%

%lamp = 55.7%

Conical surface Flux(120deg): 2129.3 lm

%lum = 79.8%


%lamp = 79.8%

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		

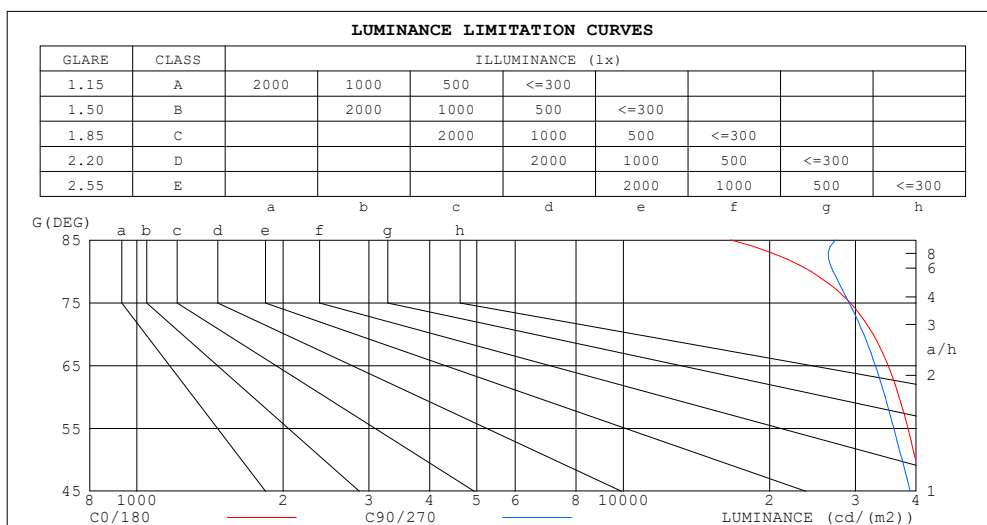

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	16653	27336
80	24308	27002
75	29280	29129
70	32626	31213
65	35045	32983
60	36911	34534
55	38479	35988
50	39886	37423
45	41189	38877


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.04	.00	.96	1.02	.98	.94	.98	.94	.92	.94	.91	.89	.90	.88	.86	.84
2.0	.91	.84	.79	.89	.83	.78	.86	.80	.76	.82	.78	.74	.79	.76	.72	.70
3.0	.80	.72	.66	.79	.71	.65	.76	.69	.64	.73	.67	.63	.70	.66	.62	.59
4.0	.71	.62	.56	.70	.62	.55	.67	.60	.55	.65	.59	.54	.63	.58	.53	.51
5.0	.64	.55	.48	.63	.54	.48	.60	.53	.47	.58	.52	.47	.57	.51	.46	.44
6.0	.57	.49	.42	.57	.48	.42	.55	.47	.42	.53	.46	.41	.51	.46	.41	.39
7.0	.52	.44	.37	.51	.43	.37	.50	.42	.37	.48	.42	.37	.47	.41	.36	.34
8.0	.48	.39	.33	.47	.39	.33	.46	.38	.33	.44	.38	.33	.43	.37	.33	.31
9.0	.44	.36	.30	.43	.35	.30	.42	.35	.30	.41	.34	.30	.40	.34	.30	.28
10.0	.41	.33	.27	.40	.32	.27	.39	.32	.27	.38	.32	.27	.37	.31	.27	.25

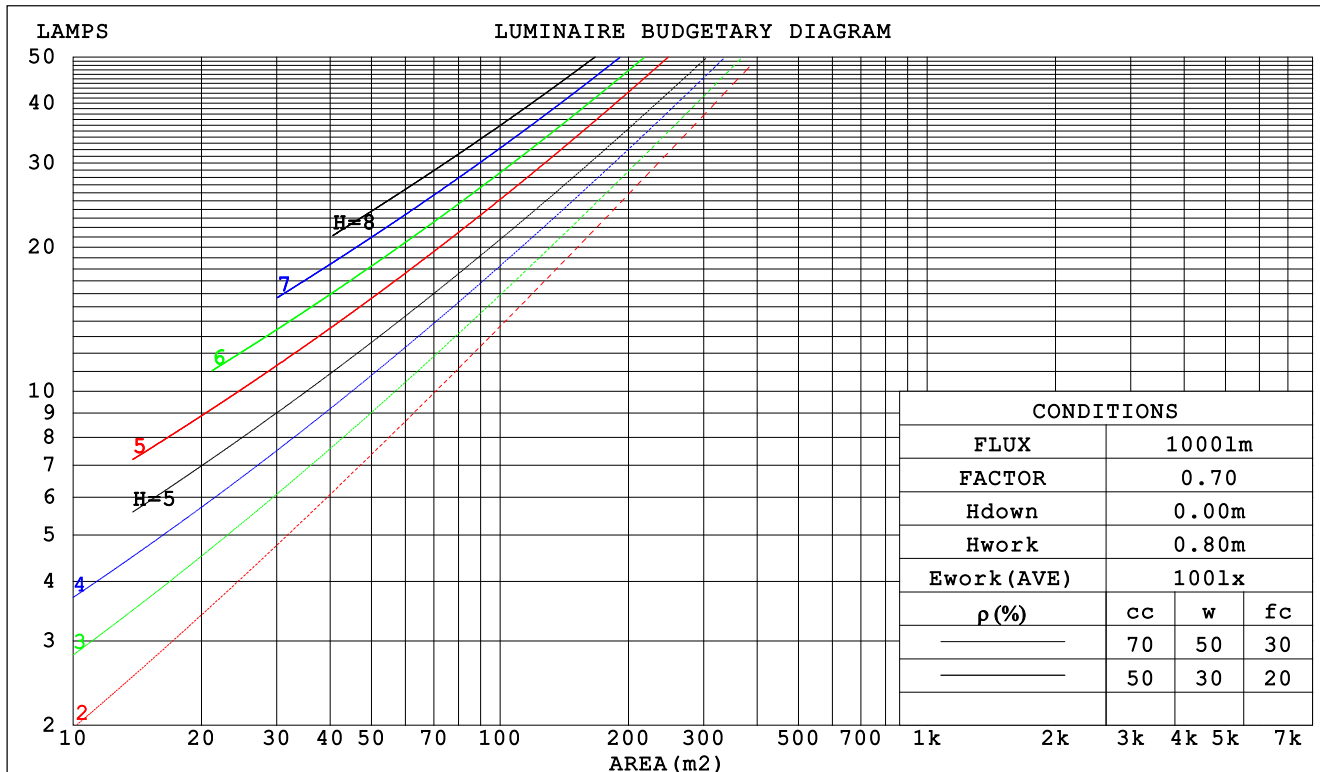

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm											
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90											
MFR.: DARKON											

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)									
0.0																
1.0	.305	.173	.055	.298	.170	.054	.285	.163	.052	.272	.157	.050	.261	.151	.049	
2.0	.287	.157	.048	.280	.154	.048	.269	.149	.046	.258	.145	.045	.248	.140	.044	
3.0	.265	.141	.042	.260	.139	.042	.250	.135	.041	.240	.132	.040	.231	.128	.040	
4.0	.245	.127	.037	.240	.126	.037	.231	.123	.037	.223	.120	.036	.215	.117	.036	
5.0	.227	.116	.033	.222	.114	.033	.214	.112	.033	.207	.109	.032	.200	.107	.032	
6.0	.210	.105	.030	.207	.104	.030	.199	.102	.030	.193	.100	.029	.186	.098	.029	
7.0	.196	.097	.027	.193	.096	.027	.186	.094	.027	.180	.092	.027	.175	.091	.027	
8.0	.183	.090	.025	.180	.089	.025	.174	.087	.025	.169	.086	.025	.164	.084	.025	
9.0	.172	.083	.023	.169	.082	.023	.164	.081	.023	.159	.080	.023	.155	.078	.023	
10.0	.162	.078	.022	.159	.077	.021	.155	.076	.021	.150	.075	.021	.146	.073	.021	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.180	.156	.135	.154	.134	.116	.105	.092	.080	.061	.053	.047	.019	.017	.015	
2.0	.172	.132	.099	.147	.114	.085	.101	.079	.059	.058	.046	.035	.019	.015	.011	
3.0	.164	.114	.075	.140	.099	.065	.096	.068	.046	.056	.040	.027	.018	.013	.009	
4.0	.156	.101	.059	.134	.087	.051	.092	.061	.036	.053	.036	.021	.017	.012	.007	
5.0	.148	.090	.048	.127	.078	.042	.088	.055	.029	.051	.032	.017	.016	.010	.006	
6.0	.141	.082	.040	.121	.071	.034	.084	.050	.024	.049	.029	.015	.016	.010	.005	
7.0	.134	.075	.034	.116	.065	.029	.080	.046	.021	.046	.027	.012	.015	.009	.004	
8.0	.128	.069	.029	.110	.060	.025	.076	.042	.018	.044	.025	.011	.014	.008	.004	
9.0	.122	.064	.025	.105	.056	.022	.073	.039	.016	.042	.023	.009	.014	.008	.003	
10.0	.116	.060	.023	.100	.052	.020	.070	.037	.014	.041	.022	.008	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm										
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90										
MFR.: DARKON										
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	25.4	26.9	25.7	27.1	27.3	25.1	26.6	25.4	26.8	27.0
3H	26.9	28.2	27.2	28.5	28.7	26.5	27.9	26.8	28.2	28.4
4H	27.4	28.7	27.7	29.0	29.2	27.1	28.4	27.4	28.7	29.0
6H	27.7	29.0	28.1	29.3	29.5	27.6	28.8	27.9	29.1	29.4
8H	27.8	29.0	28.2	29.3	29.6	27.7	28.9	28.1	29.2	29.5
12H	27.9	29.0	28.2	29.3	29.6	27.8	29.0	28.2	29.3	29.6
4H 2H	26.0	27.3	26.3	27.5	27.8	25.7	27.0	26.0	27.3	27.5
3H	27.6	28.7	27.9	29.0	29.3	27.3	28.5	27.7	28.8	29.1
4H	28.3	29.3	28.6	29.6	30.0	28.0	29.1	28.4	29.4	29.8
6H	28.7	29.7	29.1	30.0	30.4	28.6	29.5	29.0	29.9	30.3
8H	28.9	29.7	29.3	30.1	30.5	28.8	29.7	29.2	30.1	30.4
12H	28.9	29.7	29.3	30.1	30.5	29.0	29.8	29.4	30.2	30.6
8H 4H	28.5	29.4	28.9	29.7	30.1	28.3	29.2	28.7	29.5	29.9
6H	29.1	29.8	29.5	30.2	30.6	29.0	29.7	29.5	30.1	30.6
8H	29.3	29.9	29.8	30.4	30.8	29.3	30.0	29.8	30.4	30.8
12H	29.4	30.0	29.9	30.4	30.9	29.6	30.1	30.1	30.6	31.1
12H 4H	28.5	29.3	28.9	29.7	30.1	28.3	29.1	28.7	29.5	29.9
6H	29.1	29.8	29.6	30.2	30.7	29.1	29.7	29.5	30.1	30.6
8H	29.4	29.9	29.9	30.4	30.9	29.4	30.0	29.9	30.4	30.9
Variations with the observer position at spacings:										
S = 1.0H	+ 0.2 / - 0.2					+ 0.2 / - 0.2				
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H	+ 0.2 / - 0.3					+ 0.2 / - 0.2				

CIE Pub.117 Corrected 2668 lm Total Lamp Luminous Flux. (8log(F/F0) = 3.4)

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	59	47	41	58	47	40	57	47	40	34
0.80	69	57	50	68	57	50	66	56	50	43
1.00	77	66	59	76	66	59	74	67	58	51
1.25	84	74	67	83	73	66	80	72	66	58
1.50	89	79	72	87	78	72	84	77	71	63
2.00	96	87	81	94	86	80	90	84	79	71
2.50	99	92	86	97	90	85	94	88	83	75
3.00	103	96	90	100	94	89	96	91	87	79
4.00	107	101	96	104	99	95	100	96	92	84
5.00	109	104	100	106	102	99	102	99	96	86
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: JEFF
 Test Date: 16 March 2023

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
 Humidity: 65.0%
 Test Distance: 7.995m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		

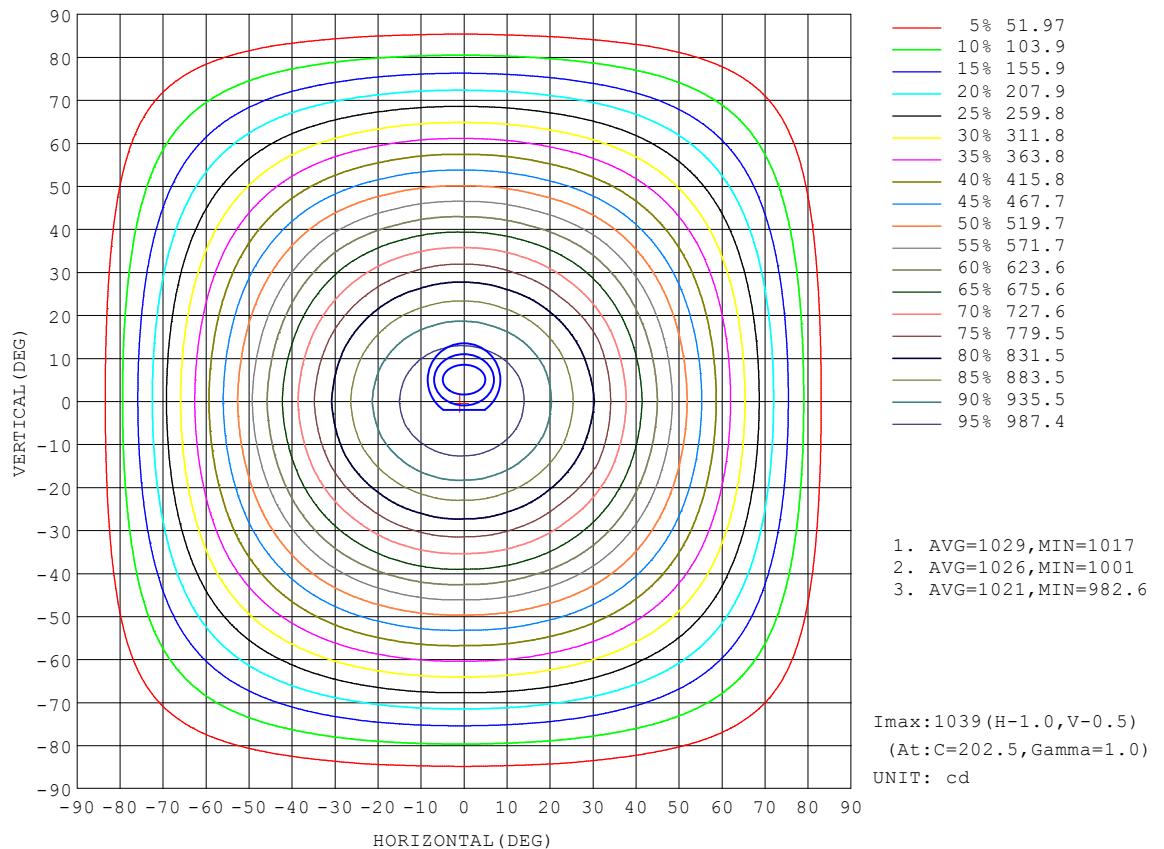


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JEFF
Test Date: 16 March 2023

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity: 65.0%
Test Distance: 7.995m [K=1.0000]
Remarks:

AAI Figure

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		

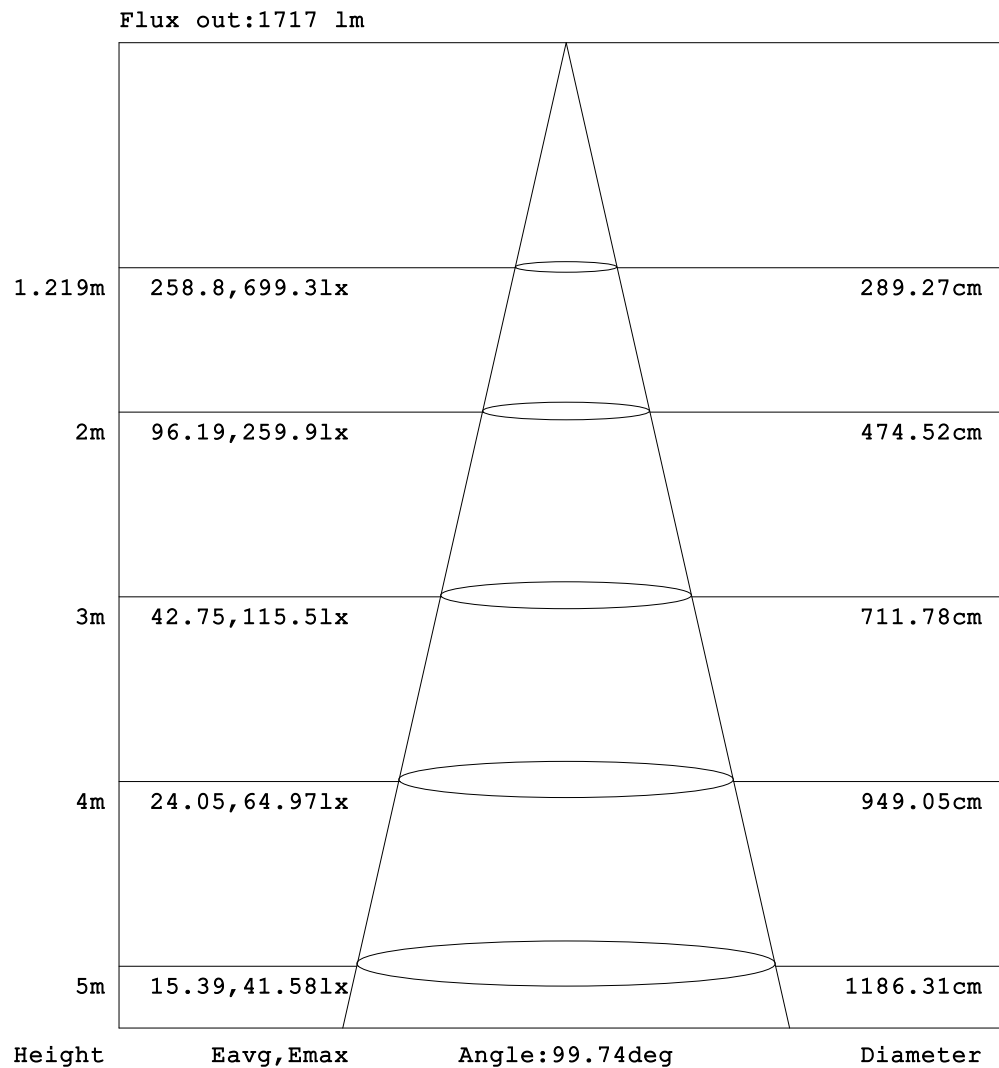


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		

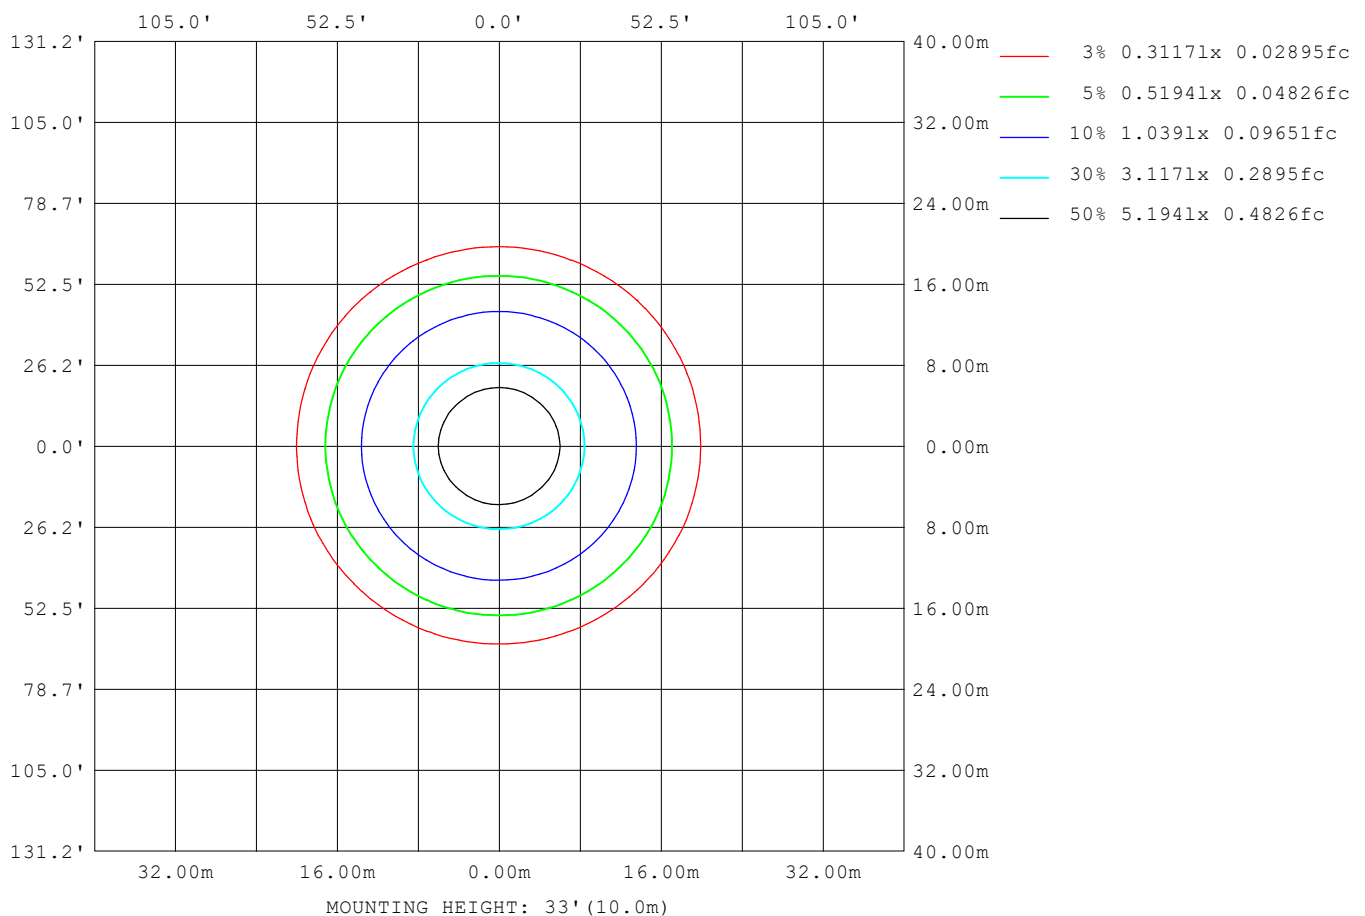

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:239.7V I:0.1442A P:32.94W PF:0.9527 Lamp Flux:2668.41x1 lm		
NAME: GRAZER_1146_NA_WHT_OV_HE_450mA_4000K CRI90		
MFR.: DARKON		


AvgL	cd/m2
L_0~180 (65) av	35571
L_0~180 (75) av	29905
L_0~180 (85) av	17588
L_90~270 (65) av	33561
L_90~270 (75) av	30101
L_90~270 (85) av	28492
L_45 (65) av	34585
L_45 (75) av	30237
L_45 (85) av	24436

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:16 March 2023

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.995m [K=1.0000]
Remarks:

Planar Illuminance Curve

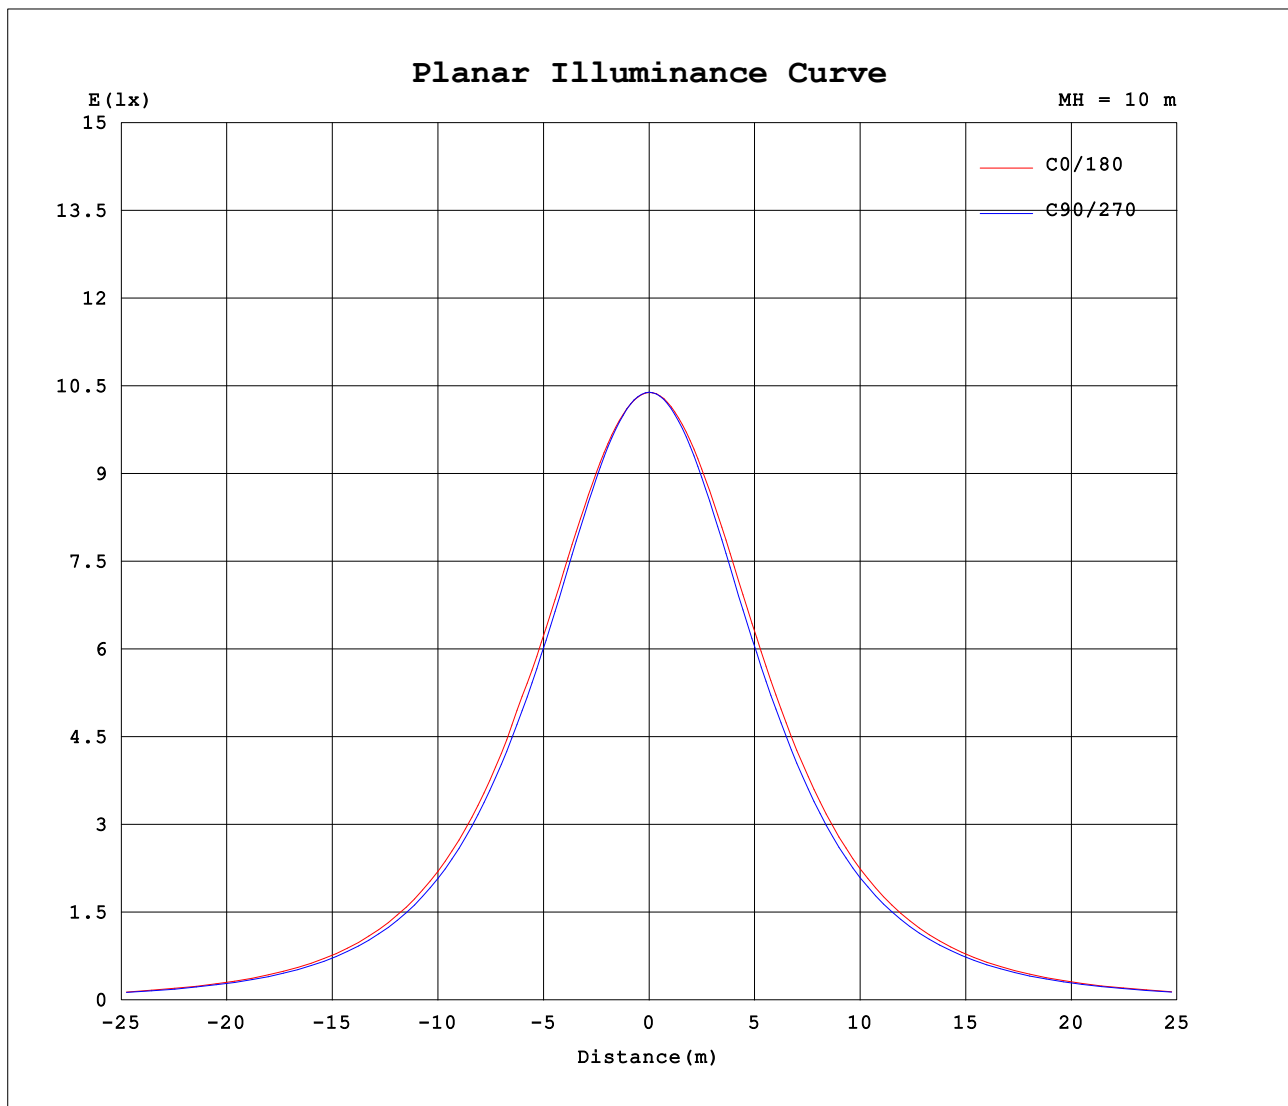

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JEFF
Test Date: 16 March 2023

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity: 65.0%
Test Distance: 7.995m [K=1.0000]
Remarks:

