


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 93.45 lm/W			
LLE 20000mm	1300lm 940 HV ADV6	Imax(cd)	918.3	S/MH(C0/180)	1.21
NOMINAL POWER(W)		LOR(%)	100.0	S/MH(C90/270)	1.19
RATED VOLTAGE(V)	230.0	TOTAL FLUX(lm)	2402.1	η UP,DN(C0-180)	0.0,49.9
NOMINAL FLUX(lm)	2402.08	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.1
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	1.25
TEST VOLTAGE(V)	230	η down(%)	100.0	CIBSE SHR MAX	1.35

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

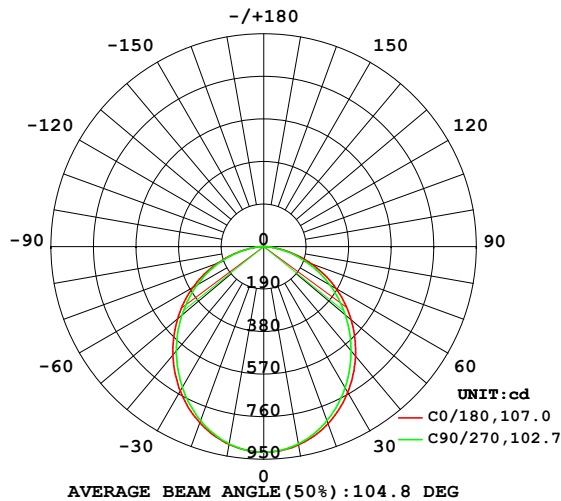

C0 PLANE ISOLUX DIAGRAM (UNIT:lx)

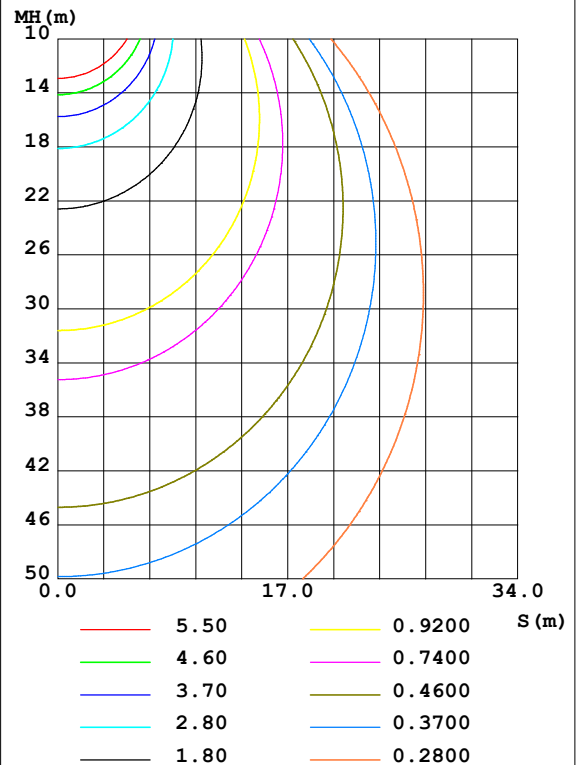

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	898.9	895.7	894.5	896.7	896.7	896.4	894.0	895.7	0- 10	86.60	86.60	3.61,3.61
20	841.1	831.8	827.0	833.5	836.9	833.6	826.4	831.9	10- 20	244.9	331.5	13.8,13.8
30	751.1	736.1	727.0	738.2	745.7	738.6	726.8	736.3	20- 30	363.1	694.6	28.9,28.9
40	638.2	618.8	606.9	621.2	631.8	622.2	607.4	619.9	30- 40	426.0	1121	46.7,46.7
50	510.0	488.8	475.8	491.5	503.4	493.6	477.9	491.0	40- 50	429.8	1550	64.5,64.5
60	372.1	351.5	340.0	354.3	365.1	357.8	344.0	355.0	50- 60	378.8	1929	80.3,80.3
70	228.0	210.5	203.0	213.5	221.2	218.4	208.8	215.6	60- 70	281.9	2211	92.1,92.1
80	87.92	77.92	75.89	80.62	82.28	85.84	82.29	83.25	70- 80	154.8	2366	98.5,98.5
90	1.161	0.6705	0.6120	0.6635	0.6410	1.066	0.8209	0.6268	80- 90	36.16	2402	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1338.6 lm

%lum = 55.7%

%lamp = 55.7%

Conical surface Flux(120deg): 1929.2 lm

%lum = 80.3%


%lamp = 80.3%

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:

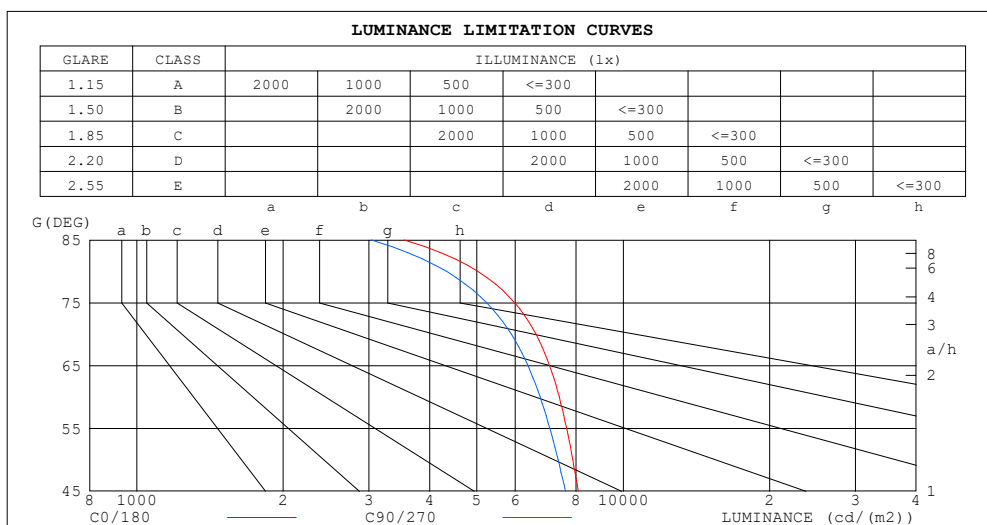


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JEFF
Test Date: 23 January 2025

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity: 65.0%
Test Distance: 7.889m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.04	1.00	.96	1.02	.98	.95	.98	.95	.92	.94	.91	.89	.90	.88	.86	.84
2.0	.91	.85	.79	.89	.83	.78	.86	.81	.76	.83	.78	.74	.80	.76	.73	.71
3.0	.80	.72	.66	.79	.71	.65	.76	.69	.64	.73	.68	.63	.70	.66	.62	.60
4.0	.71	.63	.56	.70	.62	.56	.67	.60	.55	.65	.59	.54	.63	.58	.53	.51
5.0	.64	.55	.48	.63	.54	.48	.61	.53	.48	.59	.52	.47	.57	.51	.46	.44
6.0	.58	.49	.42	.57	.48	.42	.55	.47	.42	.53	.46	.41	.51	.46	.41	.39
7.0	.52	.44	.37	.51	.43	.37	.50	.42	.37	.48	.42	.37	.47	.41	.36	.34
8.0	.48	.39	.33	.47	.39	.33	.46	.38	.33	.44	.38	.33	.43	.37	.33	.31
9.0	.44	.36	.30	.43	.35	.30	.42	.35	.30	.41	.34	.30	.40	.34	.30	.28
10.0	.40	.33	.27	.40	.32	.27	.39	.32	.27	.38	.32	.27	.37	.31	.27	.25

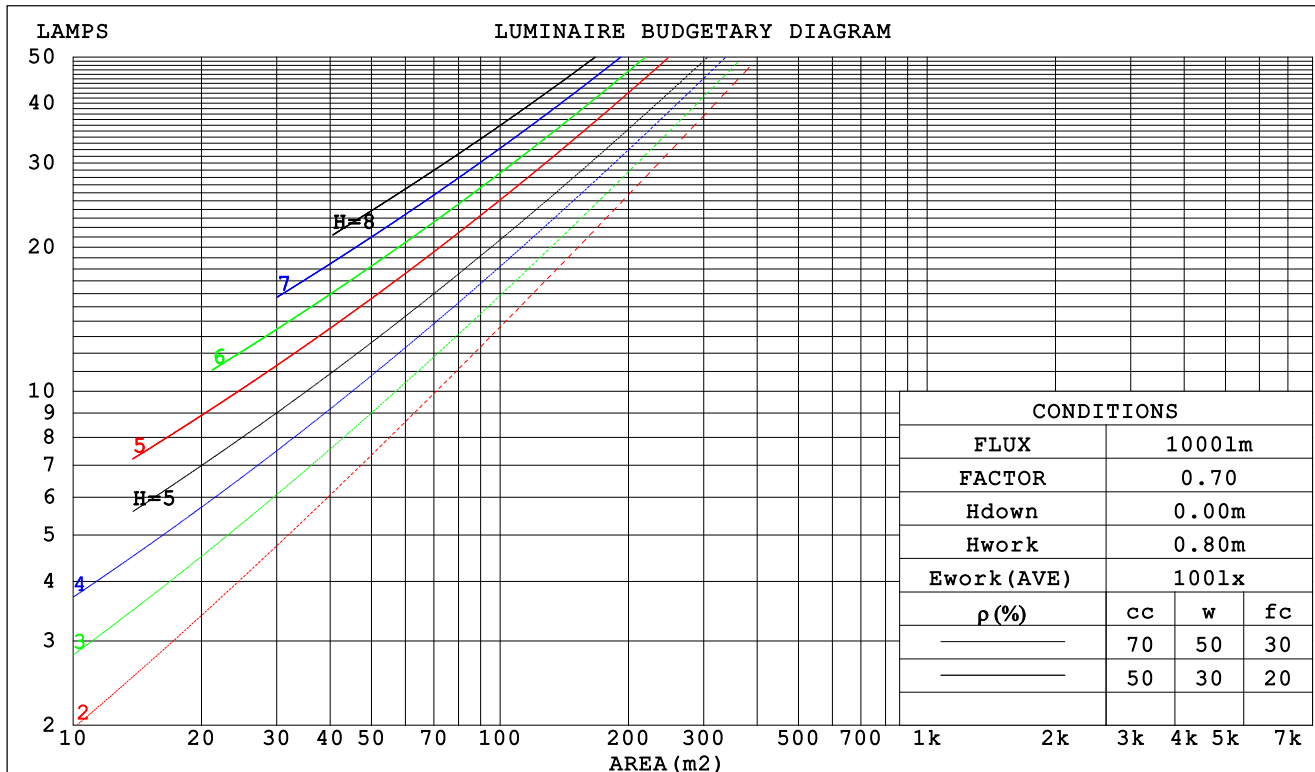

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)										
0.0																	
1.0	.300	.171	.054	.293	.167	.053	.280	.161	.051	.268	.154	.050	.256	.149	.048		
2.0	.284	.156	.048	.278	.153	.047	.266	.148	.046	.256	.143	.045	.246	.139	.044		
3.0	.264	.141	.042	.259	.138	.042	.248	.135	.041	.239	.131	.040	.230	.127	.039		
4.0	.244	.127	.037	.240	.125	.037	.230	.122	.036	.222	.119	.036	.214	.116	.035		
5.0	.226	.115	.033	.222	.114	.033	.214	.111	.033	.206	.109	.032	.199	.107	.032		
6.0	.210	.105	.030	.207	.104	.030	.199	.102	.030	.193	.100	.029	.186	.098	.029		
7.0	.196	.097	.027	.193	.096	.027	.186	.094	.027	.180	.092	.027	.175	.091	.027		
8.0	.183	.090	.025	.180	.089	.025	.174	.087	.025	.169	.086	.025	.164	.084	.025		
9.0	.172	.083	.023	.169	.082	.023	.164	.081	.023	.159	.080	.023	.155	.079	.023		
10.0	.162	.078	.022	.159	.077	.021	.155	.076	.021	.150	.075	.021	.146	.074	.021		

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.180	.156	.135	.154	.134	.116	.105	.092	.080	.061	.053	.047	.019	.017	.015	
2.0	.171	.132	.099	.147	.114	.086	.101	.079	.060	.058	.046	.035	.019	.015	.011	
3.0	.163	.114	.075	.140	.099	.065	.096	.068	.046	.056	.040	.027	.018	.013	.009	
4.0	.156	.101	.059	.134	.087	.051	.092	.061	.036	.053	.036	.021	.017	.012	.007	
5.0	.148	.090	.048	.127	.078	.042	.088	.055	.029	.051	.032	.017	.016	.010	.006	
6.0	.141	.082	.040	.121	.071	.035	.084	.050	.024	.049	.029	.015	.016	.010	.005	
7.0	.134	.075	.034	.116	.065	.029	.080	.046	.021	.046	.027	.012	.015	.009	.004	
8.0	.128	.069	.029	.110	.060	.025	.076	.042	.018	.044	.025	.011	.014	.008	.004	
9.0	.122	.064	.025	.105	.056	.022	.073	.039	.016	.042	.023	.009	.014	.008	.003	
10.0	.116	.060	.023	.100	.052	.020	.070	.037	.014	.041	.022	.008	.013	.007	.003	

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm										
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6								WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:1		
MFR.: DARKON					SUR.:			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	19.9	21.4	20.2	21.6	21.8	19.5	21.0	19.8	21.2	21.4
3H	21.4	22.7	21.7	23.0	23.2	20.9	22.3	21.2	22.5	22.7
4H	21.9	23.2	22.2	23.5	23.7	21.4	22.7	21.7	23.0	23.2
6H	22.3	23.5	22.6	23.8	24.1	21.7	23.0	22.1	23.2	23.5
8H	22.4	23.6	22.7	23.9	24.2	21.8	23.0	22.1	23.3	23.6
12H	22.4	23.6	22.8	23.9	24.2	21.8	23.0	22.2	23.3	23.6
4H 2H	20.4	21.7	20.7	22.0	22.2	20.1	21.4	20.4	21.7	21.9
3H	22.1	23.2	22.4	23.5	23.8	21.7	22.8	22.0	23.1	23.4
4H	22.8	23.8	23.1	24.1	24.5	22.3	23.3	22.7	23.7	24.0
6H	23.2	24.2	23.6	24.5	24.9	22.7	23.7	23.1	24.0	24.4
8H	23.4	24.2	23.8	24.6	25.0	22.8	23.7	23.3	24.1	24.5
12H	23.4	24.2	23.9	24.6	25.0	22.9	23.7	23.3	24.1	24.5
8H 4H	22.9	23.8	23.4	24.2	24.6	22.5	23.4	23.0	23.8	24.2
6H	23.5	24.3	24.0	24.7	25.1	23.1	23.8	23.5	24.2	24.6
8H	23.7	24.4	24.2	24.8	25.3	23.3	23.9	23.7	24.3	24.8
12H	23.9	24.4	24.3	24.9	25.3	23.4	23.9	23.8	24.4	24.8
12H 4H	22.9	23.7	23.4	24.1	24.5	22.5	23.3	23.0	23.7	24.1
6H	23.6	24.2	24.0	24.6	25.1	23.1	23.8	23.6	24.2	24.6
8H	23.8	24.3	24.3	24.8	25.3	23.3	23.9	23.8	24.3	24.8
Variations with the observer position at spacings:										
S = 1.0H	+ 0.2 / - 0.2					+ 0.2 / - 0.2				
1.5H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				
2.0H	+ 0.2 / - 0.3					+ 0.2 / - 0.3				

CIE Pub.117 Corrected 2402 lm Total Lamp Luminous Flux.(8log(F/F0) = 3.0)

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	59	47	40	58	47	40	57	47	40	34
0.80	69	57	50	68	57	50	66	56	50	43
1.00	77	66	59	76	66	59	74	67	58	51
1.25	84	74	67	83	73	66	80	72	66	59
1.50	89	79	73	87	78	72	84	77	71	64
2.00	96	87	81	94	86	80	90	84	79	71
2.50	100	92	86	98	91	85	94	88	83	75
3.00	103	96	91	101	95	90	97	92	88	79
4.00	107	101	97	104	99	95	100	96	93	84
5.00	109	104	100	107	102	99	102	99	96	87
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JEFF
Test Date: 23 January 2025

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity: 65.0%
Test Distance: 7.889m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:

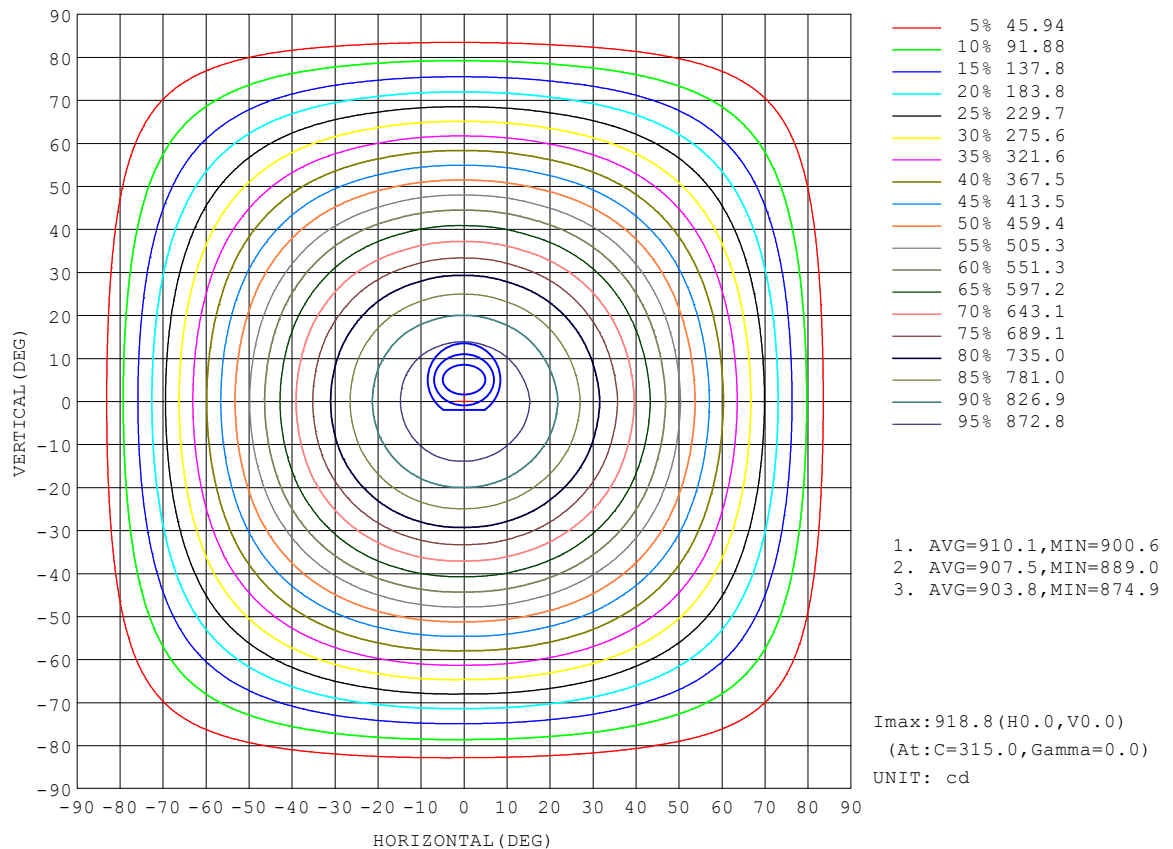


C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:

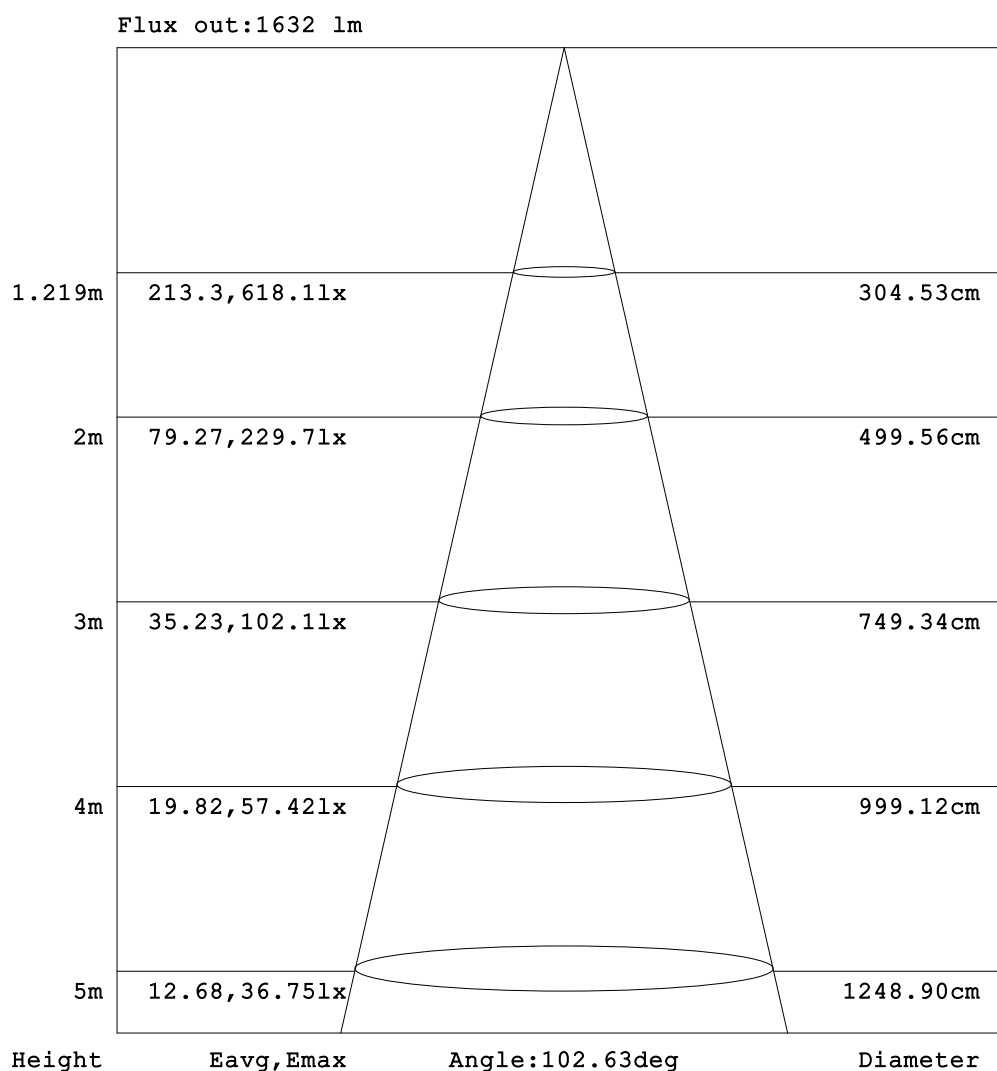


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:

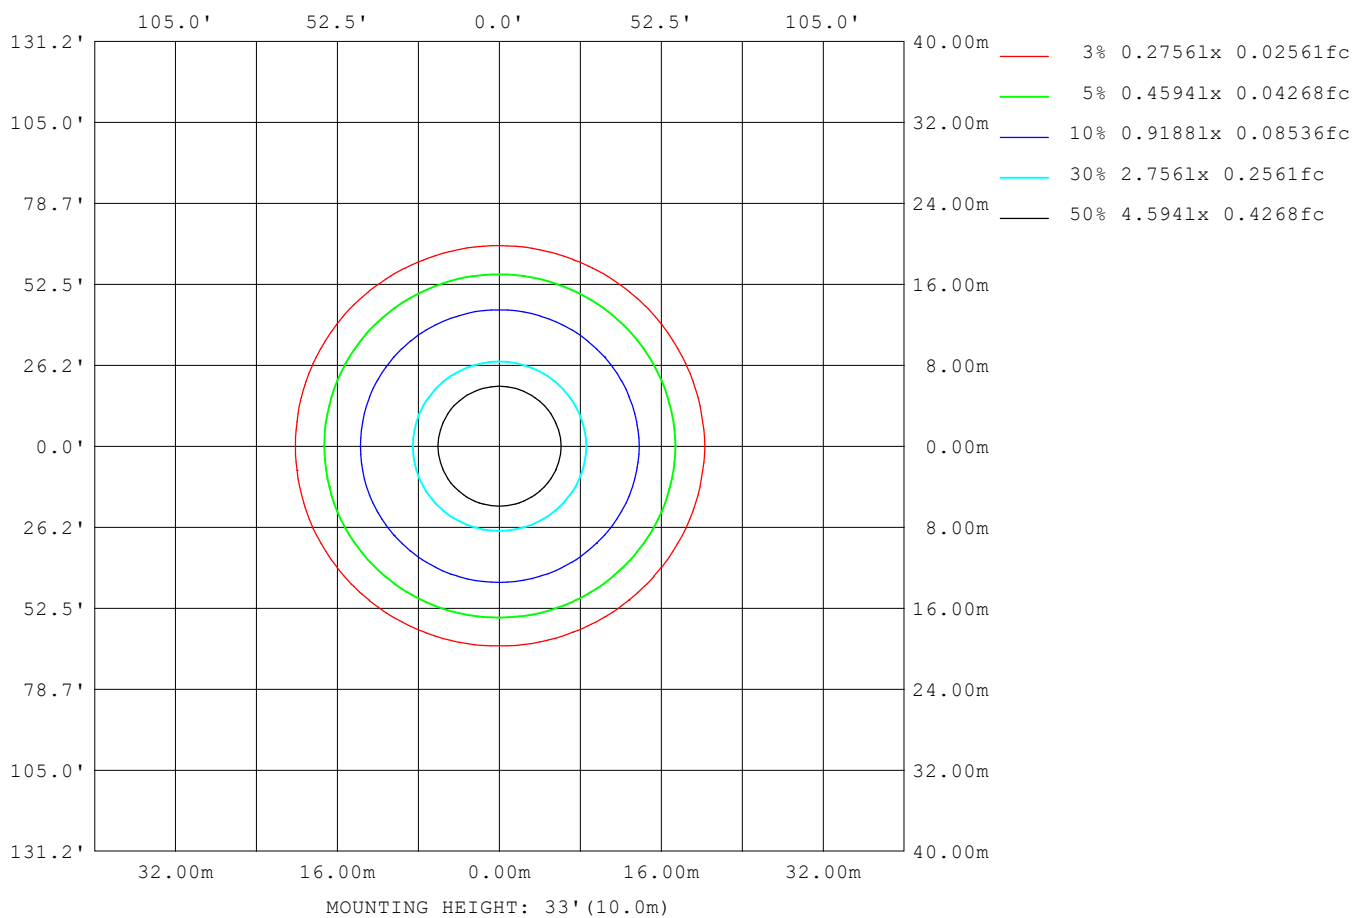

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.0V I:0.1152A P:25.70W PF:0.9295 Lamp Flux:2402.08x1 lm		
NAME: MRS T Mk2_1160_NA_WHT_OPAL 7TH SAMPLE_HE_500mA_4000K CRI90 ADV6	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:1
MFR.: DARKON	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	6972
L_0~180 (75) av	5853
L_0~180 (85) av	3317
L_90~270 (65) av	6426
L_90~270 (75) av	5365
L_90~270 (85) av	3290
L_45 (65) av	6682
L_45 (75) av	5586
L_45 (85) av	3339

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:JEFF
Test Date:23 January 2025

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity:65.0%
Test Distance:7.889m [K=1.0000]
Remarks:

Planar Illuminance Curve

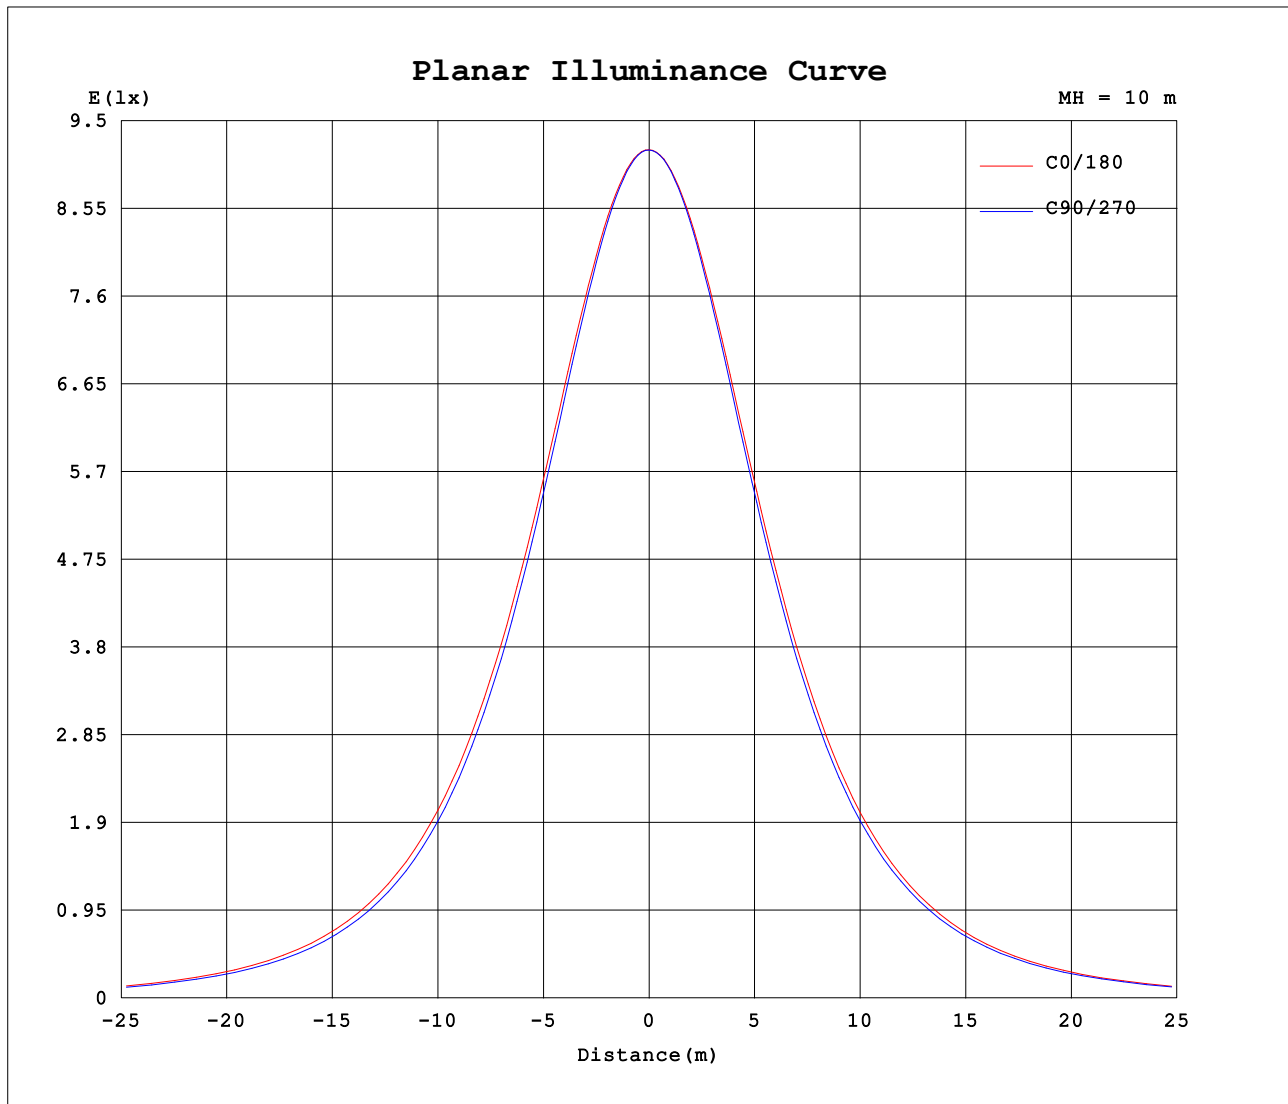

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: JEFF
Test Date: 23 January 2025

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.0.295
Humidity: 65.0%
Test Distance: 7.889m [K=1.0000]
Remarks:

